


LAMPIRAN



Gambar 5.3 Spesifikasi Sistem Kontrol Eksitasi

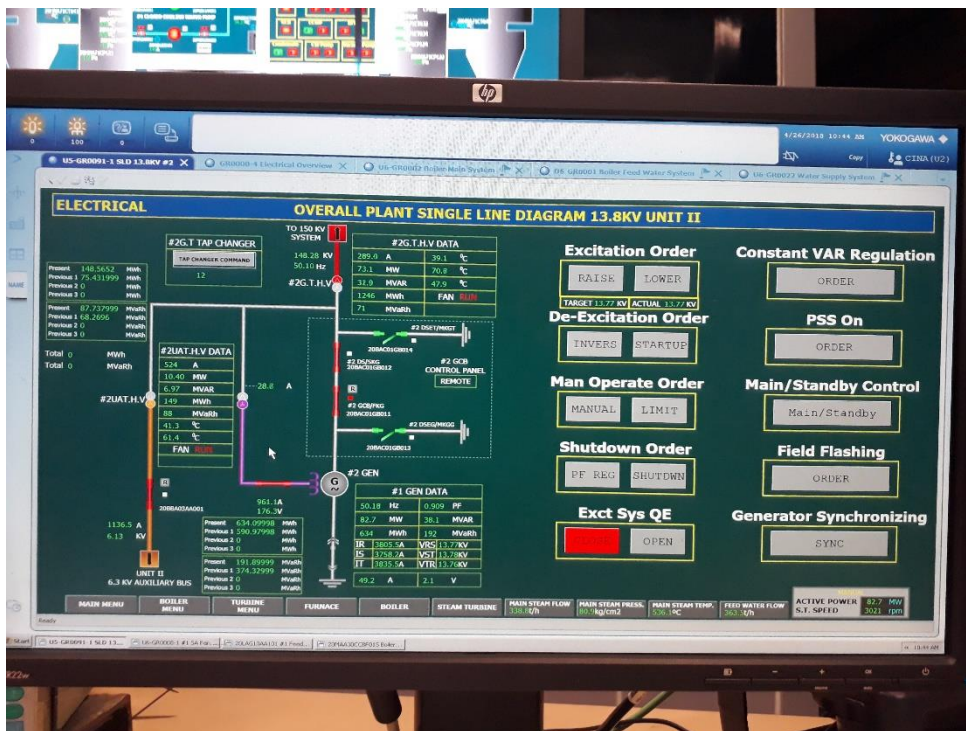

Gambar 5.4 Diagram Single Line Generator Pada Monitor



Gambar 5.5 Tampilan Governor Pada Monitor



Gambar 5.6 Spesifikasi Generator QF-110-2



Gambar 5.7 *Excitation Transformer*



Gambar 5.8 *Cubicle System Excitation*