
	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 1. Captured at: Koneksi Outgoing


Date & Time: 29/09/2017 8:08:13

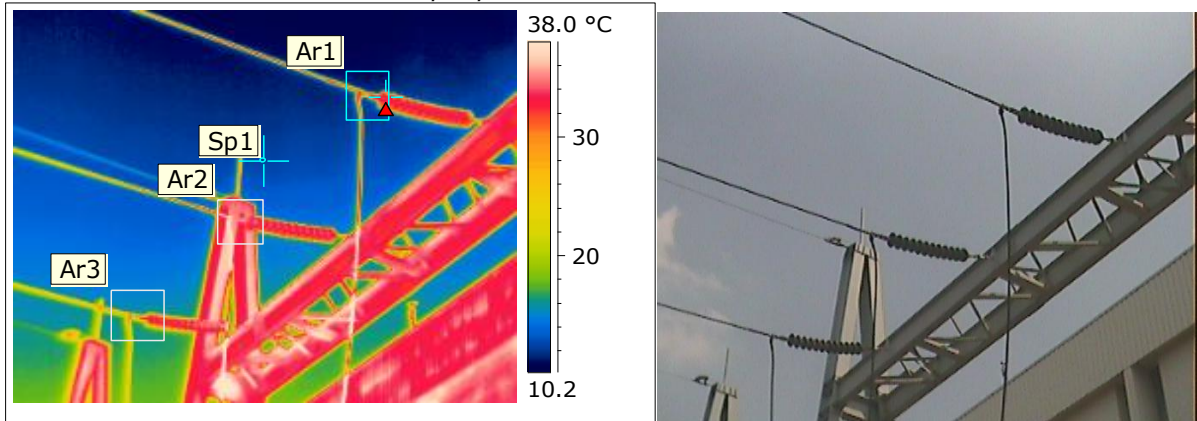


Max Temperature	40.9 °C
Ar1 Max. Temperature	33.7 °C
Ar2 Max. Temperature	39.5 °C
Ar3 Max. Temperature	33.9 °C
Sp1 Temperature	12.6 °C

Picture 2. Captured at: Bushing

Date & Time: 29/09/2017 8:12:51

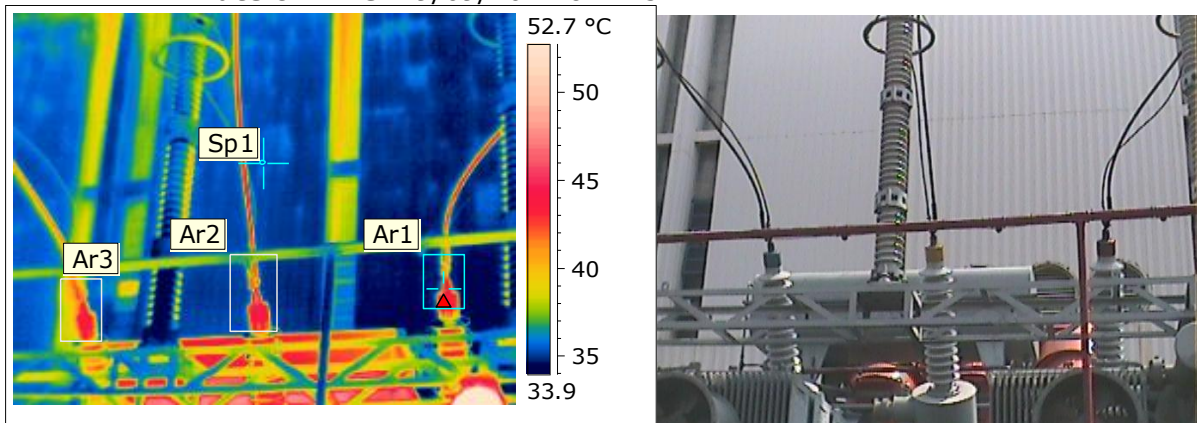


Max Temperature	56.2 °C
Ar1 Max. Temperature	45.2 °C
Ar2 Max. Temperature	46.4 °C
Ar3 Max. Temperature	44.6 °C
Sp1 Temperature	35.4 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 3. Captured at: Dinding sisi selatan


Date & Time: 29/09/2017 8:07:03

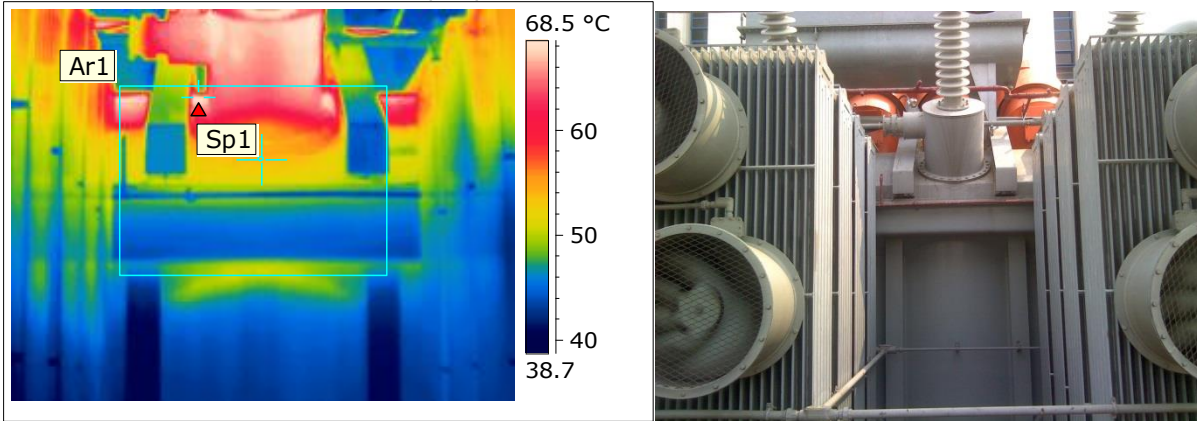


Max Temperature	68.8 °C
Ar1 Max. Temperature	68.7 °C
Sp1 Temperature	53.9 °C

Picture 4. Captured at: fin pendingin sisi selatan – barat luar

Date & Time: 29/09/2017 8:06:19

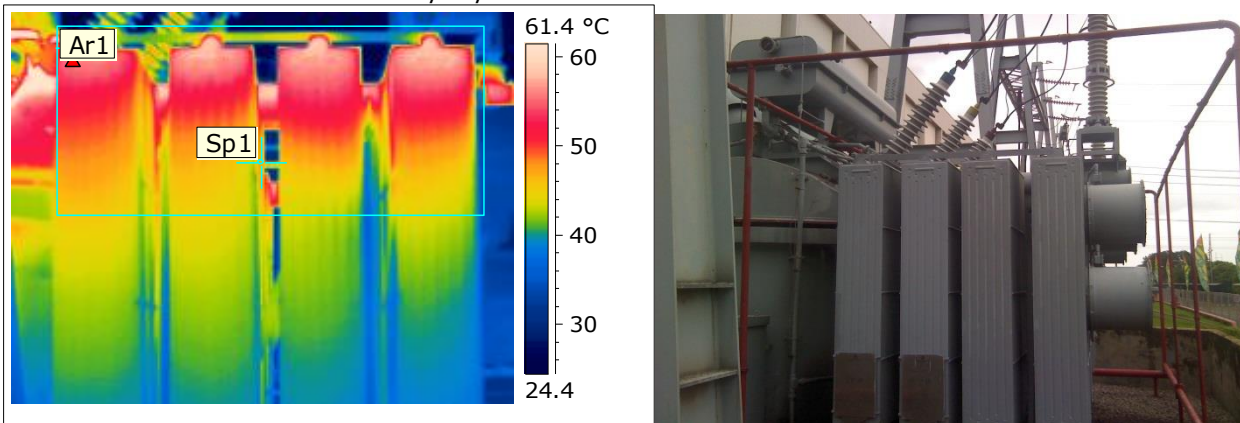


Max Temperature	65.6 °C
Ar1 Max. Temperature	60.9 °C
Sp1 Temperature	45.5 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 5. Captured at: fin pendingin sisi utara – barat (bagian luar)


Date & Time: 29/09/2017 8:05:26

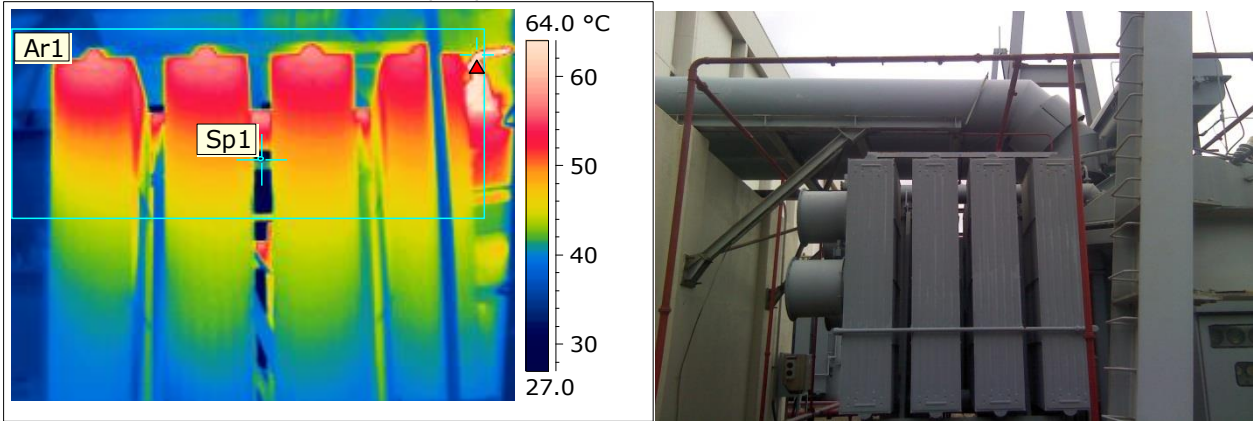


Max Temperature	66.3 °C
Ar1 Max. Temperature	66.3 °C
Sp1 Temperature	39.0 °C

Picture 6. Captured at: dinding sisi barat

Date & Time: 29/09/2017 8:05:43

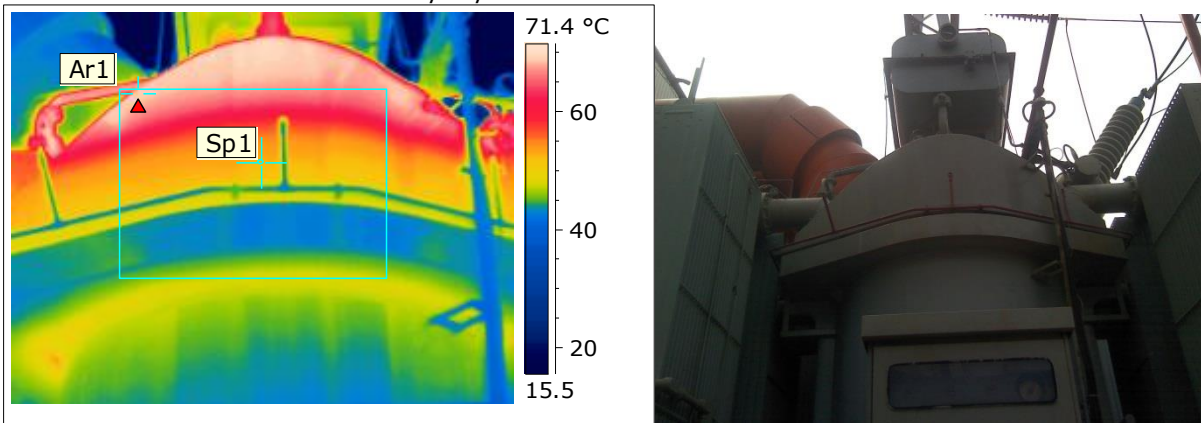


Max Temperature	69.4 °C
Ar1 Max. Temperature	68.8 °C
Sp1 Temperature	51.9 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. :
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 7. Captured at: fin pendingin sisi utara – barat (bagian dalam)


Date & Time: 29/09/2017 8:10:26

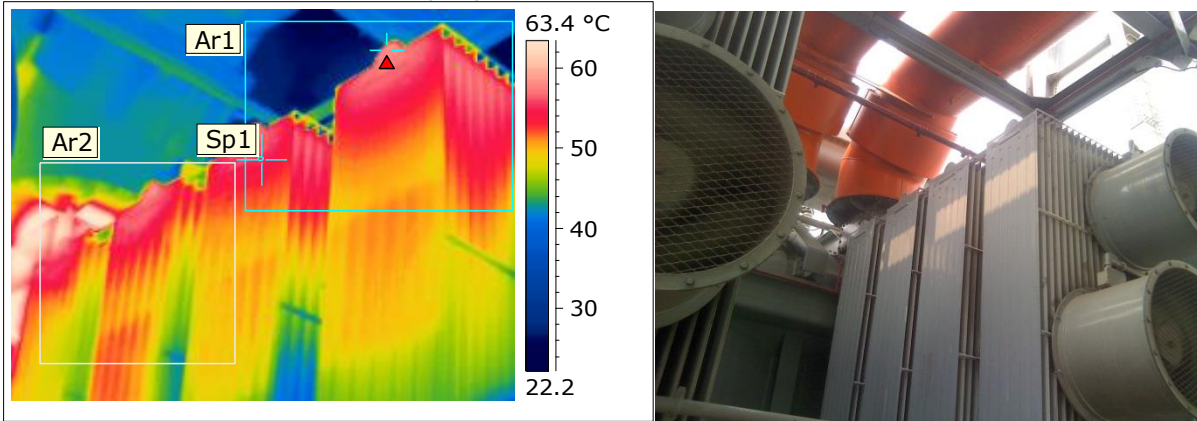


Max Temperature	65.8 °C
Ar1 Max. Temperature	58.1 °C
Ar2 Max. Temperature	64.5 °C
Sp1 Temperature	55.2 °C

Picture 8. Captured at: dinding sisi utara

Date & Time: 29/09/2017 8:04:49

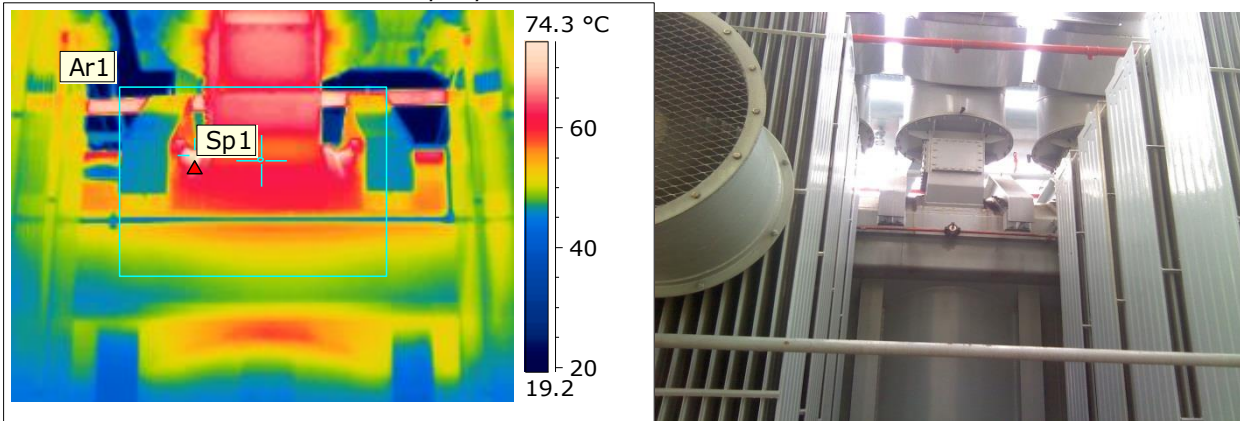


Max Temperature	75.2 °C
Ar1 Max. Temperature	75.2 °C
Sp1 Temperature	58.5 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 9. Captured at: fin pendingin sisi utara – timur (bagian dalam)


Date & Time: 29/09/2017 8:04:31

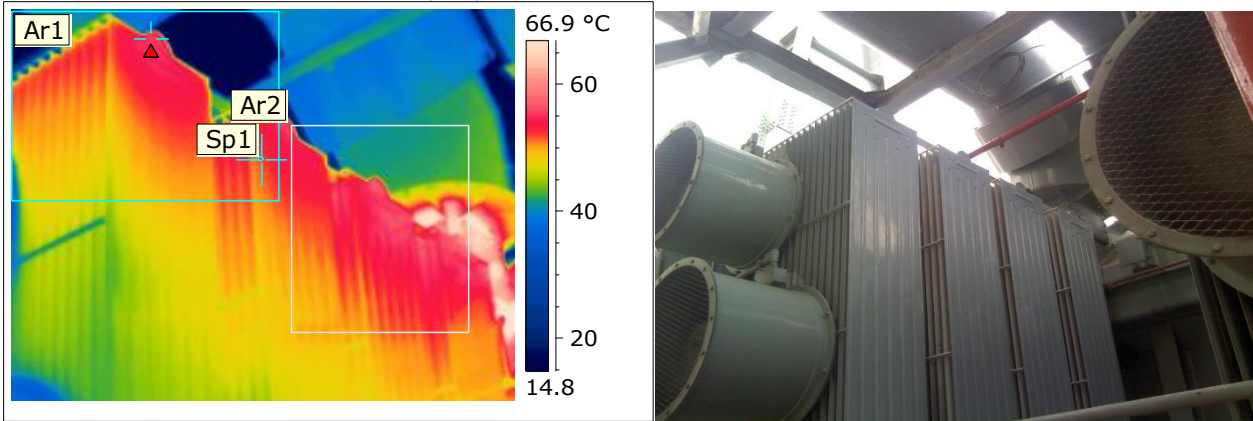


Max Temperature	72.8 °C
Ar1 Max. Temperature	55.5 °C
Ar2 Max. Temperature	67.6 °C
Sp1 Temperature	51.8 °C

Picture 10. Captured at: fin pendingin sisi utara – timur (bagian luar)

Date & Time: 29/09/2017 8:04:03

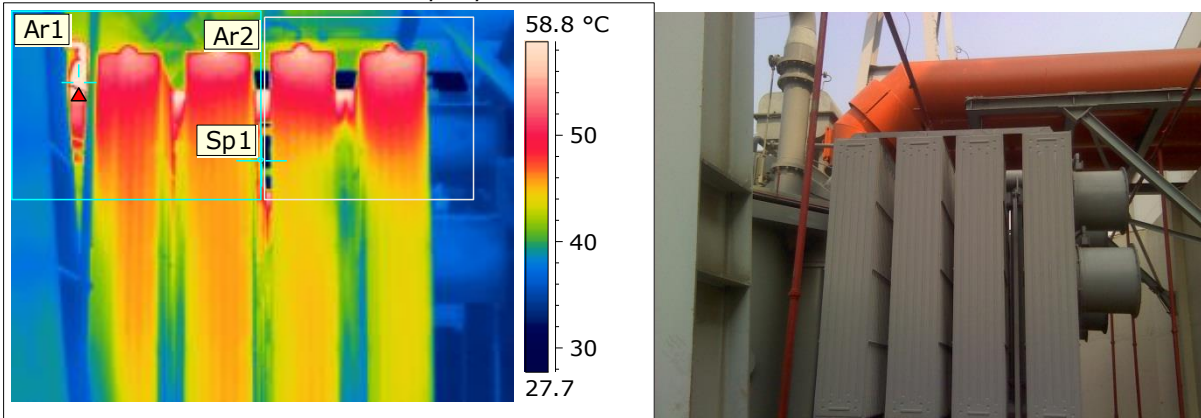


Max Temperature	64.8 °C
Ar1 Max. Temperature	64.8 °C
Ar2 Max. Temperature	59.0 °C
Sp1 Temperature	31.3 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. :
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 11. Captured at: dinding sisi timur


Date & Time: 29/09/2017 8:03:44

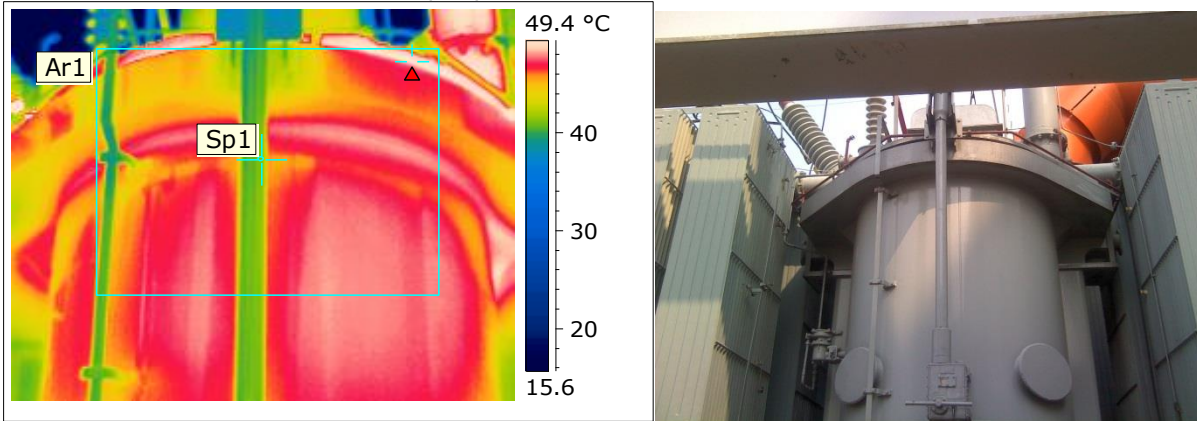


Max Temperature	62.4 °C
Ar1 Max. Temperature	49.7 °C
Sp1 Temperature	41.4 °C

Picture 12. Captured at: fin pendingin sisi selatan – timur (bagian luar)

Date & Time: 29/09/2017 8:13:15

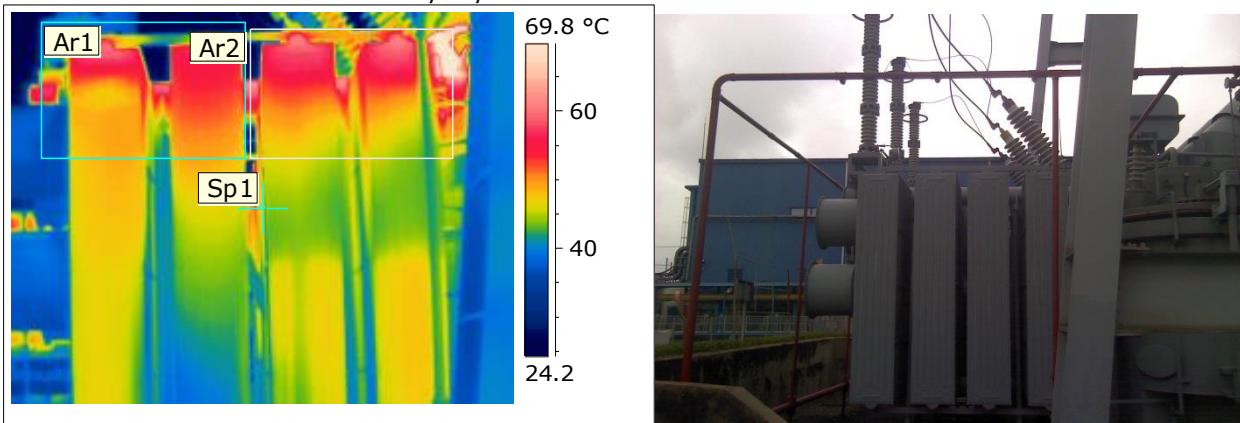


Max Temperature	72.6 °C
Ar1 Max. Temperature	61.6 °C
Ar2 Max. Temperature	72.6 °C
Sp1 Temperature	43.5 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 13. Captured at: fin pendingin sisi selatan – timur (bagian dalam)


Date & Time: 29/09/2017 8:07:18

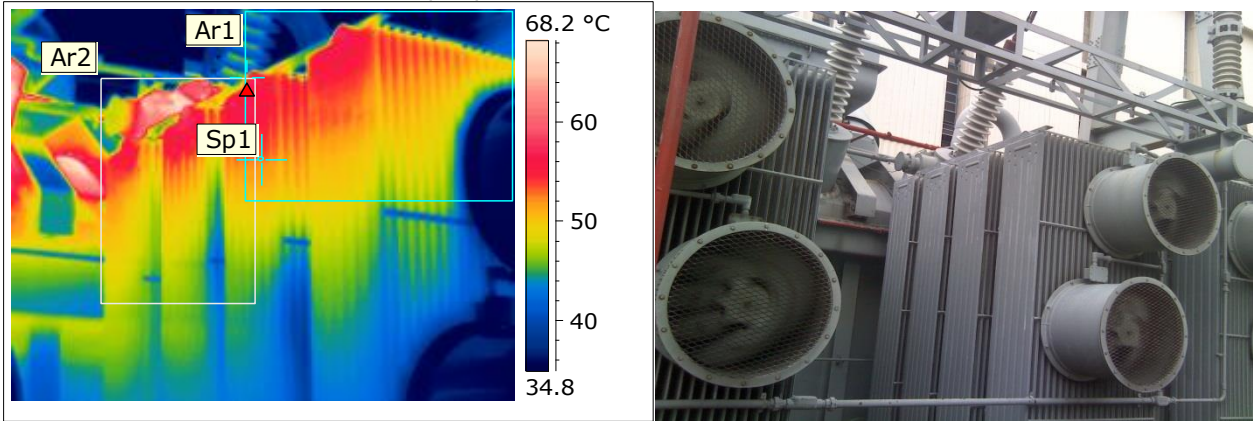


Max Temperature	68.2 °C
Ar1 Max. Temperature	57.0 °C
Ar2 Max. Temperature	67.4 °C
Sp1 Temperature	52.5 °C

Picture 14. Captured at: fin pendingin sisi selatan – barat (bagian dalam)

Date & Time: 29/09/2017 8:06:46

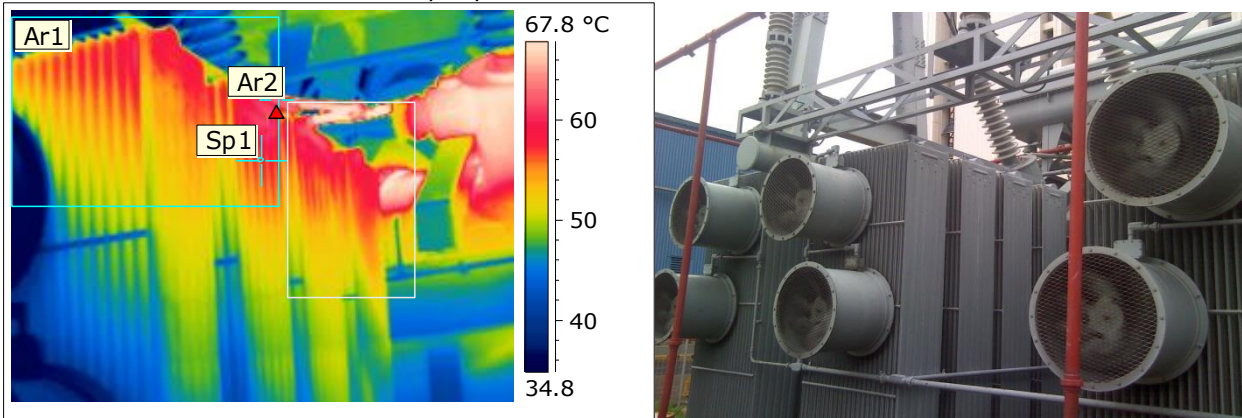


Max Temperature	68.7 °C
Ar1 Max. Temperature	63.0 °C
Ar2 Max. Temperature	68.7 °C
Sp1 Temperature	57.7 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 4	Technology : Thermograph
		Analisis : A. Doni R.

Picture 15. Captured at: Konsevator

Date & Time: 29/09/2017 8:13:29

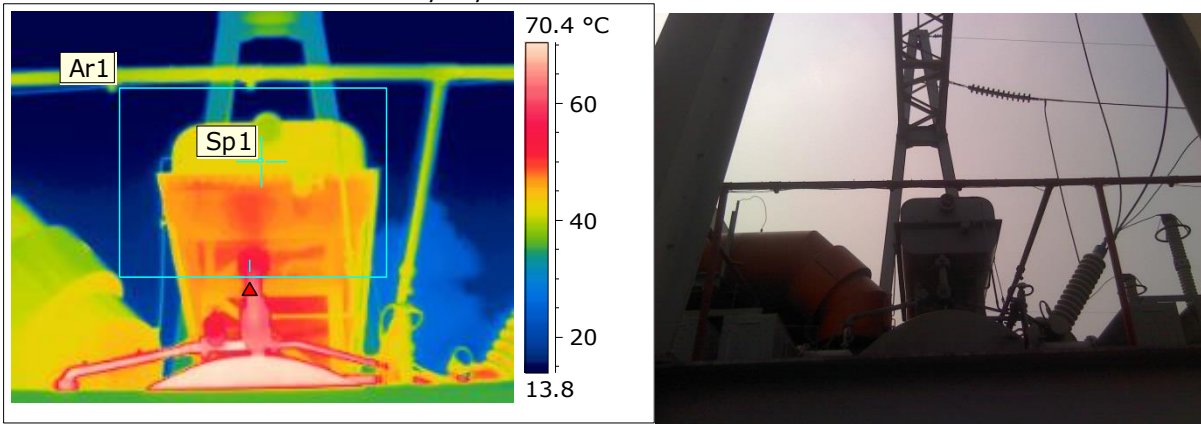

Max Temperature	71.7 °C
Ar1 Max. Temperature	61.4 °C
Sp1 Temperature	42.8 °C