
	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Technology : Thermograph
		Analisis : A. Doni R.

Picture 1. Captured at: Koneksi Outgoing


Date & Time: 29/09/2017 8:13:13

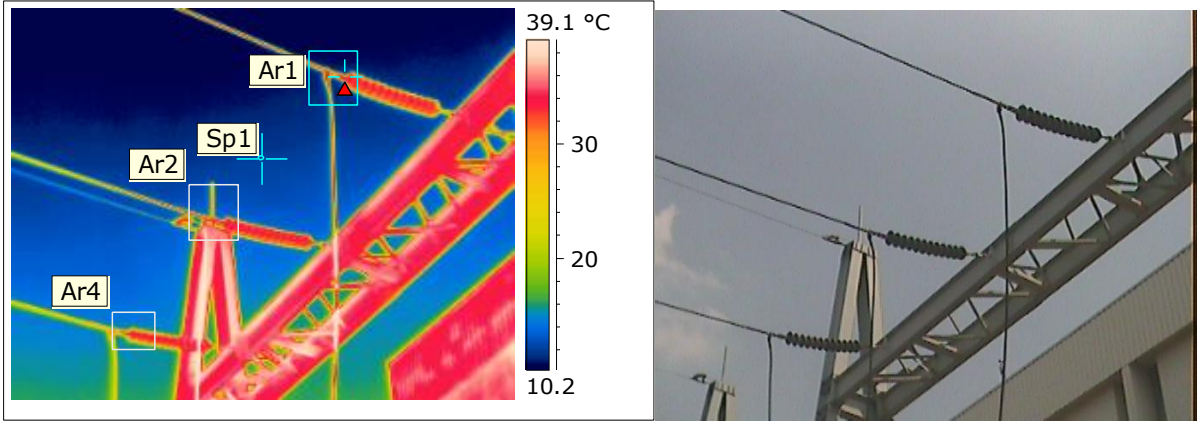


Max Temperature	41.4 °C
Ar1 Max. Temperature	34.2 °C
Ar2 Max. Temperature	39.6 °C
Ar4 Max. Temperature	34.0 °C
Sp1 Temperature	12.0 °C

Picture 2. Captured at: Bushing

Date & Time: 29/09/2017 8:12:51

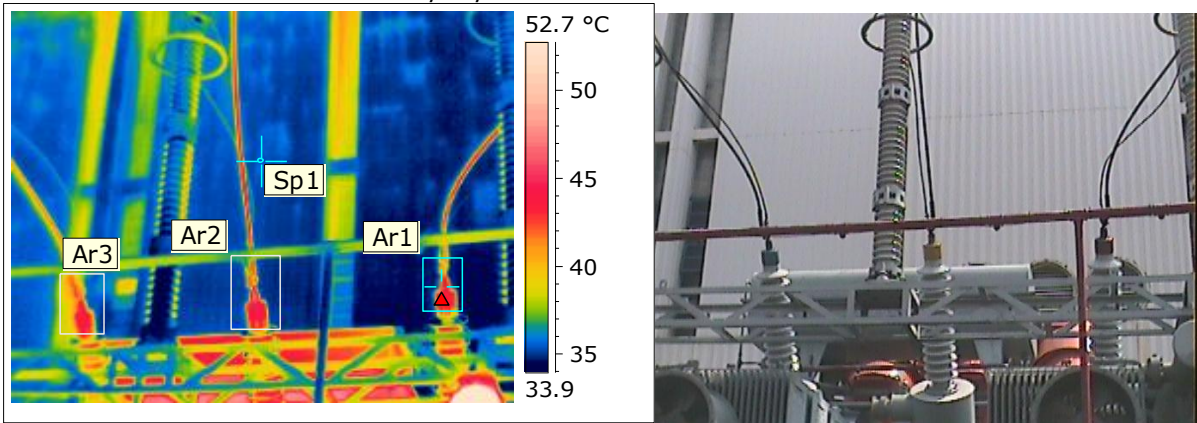


Max Temperature	56.2 °C
Ar1 Max. Temperature	45.2 °C
Ar2 Max. Temperature	46.4 °C
Ar3 Max. Temperature	44.6 °C
Sp1 Temperature	35.4 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Technology : Thermograph
		Analisis : A. Doni R.

Picture 3. Captured at: Dinding sisi selatan


Date & Time: 29/09/2017 8:12:17

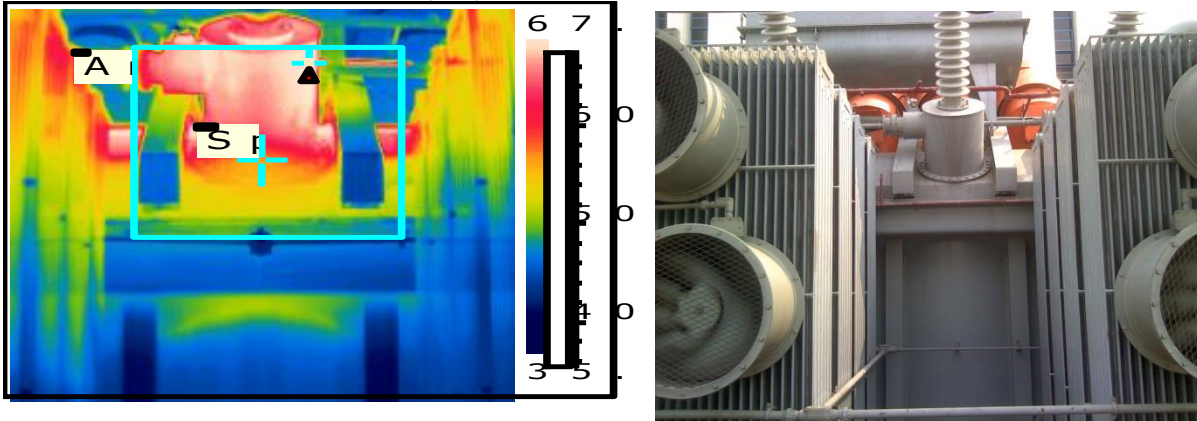


Max Temperature	68.6 °C
Ar1 Max. Temperature	68.6 °C
Sp1 Temperature	54.9 °C

Picture 4. Captured at: fin pendingin sisi selatan – barat luar

Date & Time: 29/09/2017 8:11:38

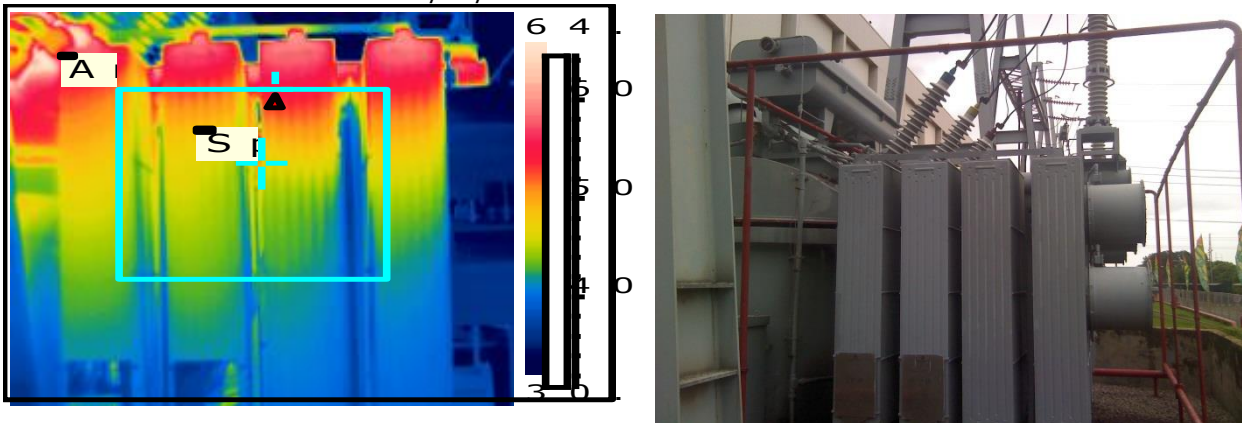


Max Temperature	64.7 °C
Ar1 Max. Temperature	53.5 °C
Sp1 Temperature	46.4 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Technology : Thermograph
		Analisis : A. Doni R.

Picture 5. Captured at: fin pendingin sisi utara – barat (bagian luar)


Date & Time: 29/09/2017 8:10:47

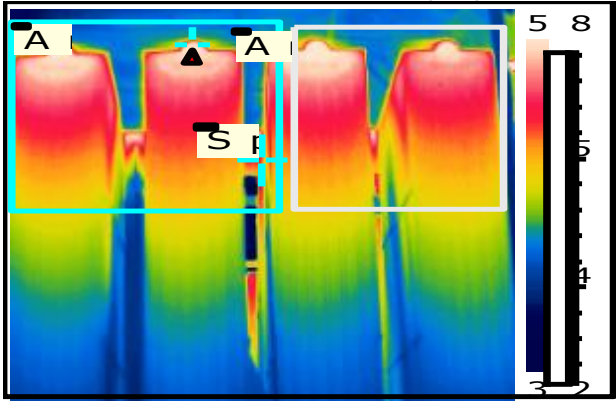


Max Temperature	66.0 °C
Ar1 Max. Temperature	58.6 °C
Ar2 Max. Temperature	59.1 °C
Sp1 Temperature	50.2 °C

Picture 6. Captured at: dinding sisi barat

Date & Time: 29/09/2017 8:11:02

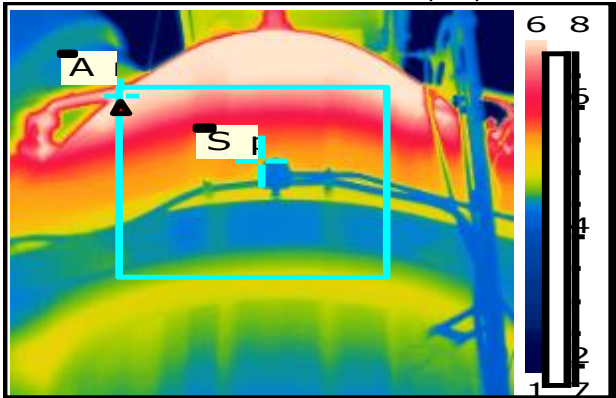


Max Temperature	69.8 °C
Ar1 Max. Temperature	68.2 °C
Sp1 Temperature	47.9 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. :
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Technology : Thermograph
		Analisis : A. Doni R.

Picture 7. Captured at: fin pendingin sisi utara – barat (bagian dalam)


Date & Time: 29/09/2017 8:05:02

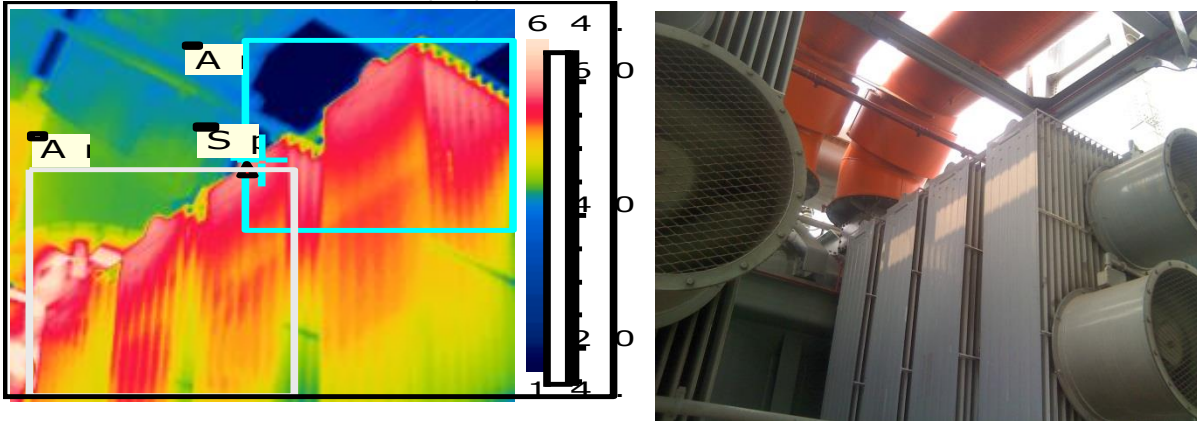


Max Temperature	73.5 °C
Ar1 Max. Temperature	58.1 °C
Ar2 Max. Temperature	66.6 °C
Sp1 Temperature	57.0 °C

Picture 8. Captured at: dinding sisi utara

Date & Time: 29/09/2017 8:10:11

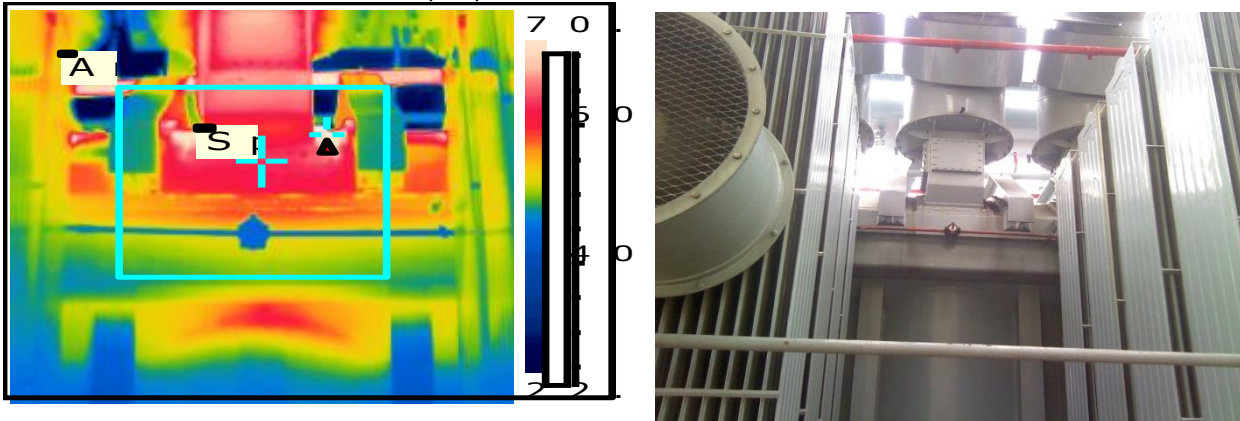


Max Temperature	78.1 °C
Ar1 Max. Temperature	78.1 °C
Sp1 Temperature	61.2 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Technology : Thermograph
		Analisis : A. Doni R.

Picture 9. Captured at: fin pendingin sisi utara – timur (bagian dalam)


Date & Time: 29/09/2017 8:09:57

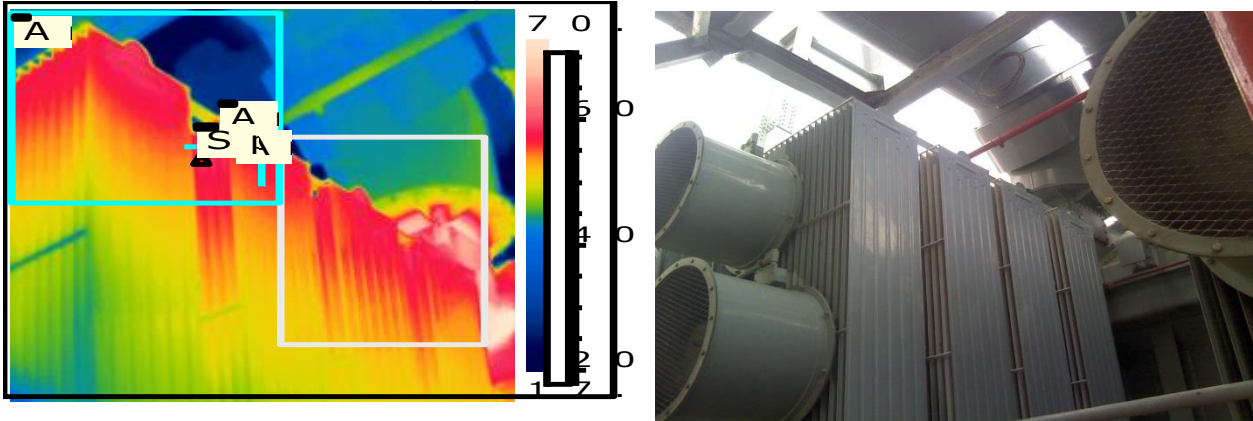


Max Temperature	80.6 °C
Ar1 Max. Temperature	57.3 °C
Ar2 Max. Temperature	55.1 °C
Ar3 Max. Temperature	69.3 °C
Sp1 Temperature	54.7 °C

Picture 10. Captured at: fin pendingin sisi utara – timur (bagian luar)

Date & Time: 29/09/2017 8:09:35

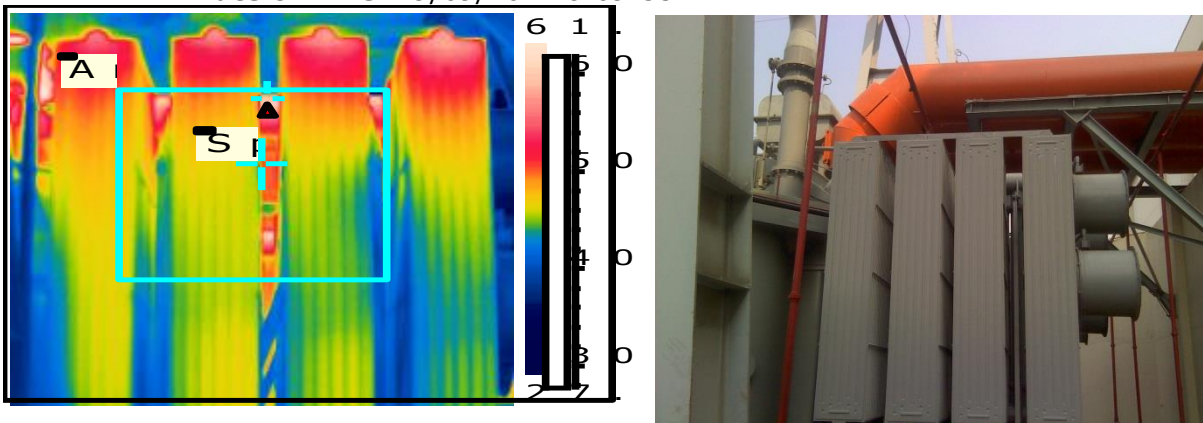


Max Temperature	63.4 °C
Ar1 Max. Temperature	59.2 °C
Sp1 Temperature	49.1 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Technology : Thermograph
		Analisis : A. Doni R.

Picture 11. Captured at: dinding sisi timur


Date & Time: 29/09/2017 8:03:44

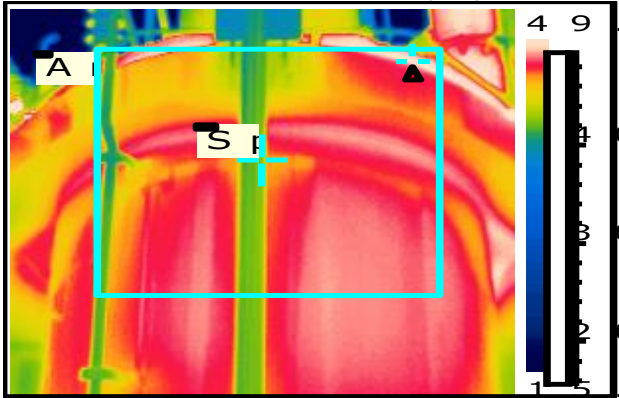


Max Temperature	62.4 °C
Ar1 Max. Temperature	49.7 °C
Sp1 Temperature	41.4 °C

Picture 12. Captured at: fin pendingin sisi selatan – timur (bagian luar)

Date & Time: 29/09/2017 8:12:15

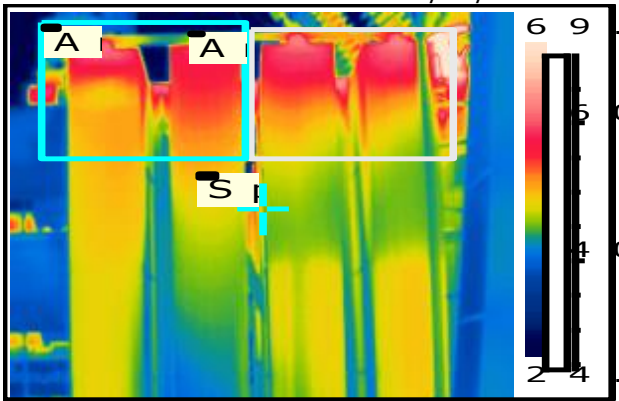


Max Temperature	72.6 °C
Ar1 Max. Temperature	61.6 °C
Ar2 Max. Temperature	72.6 °C
Sp1 Temperature	43.5 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Technology : Thermograph
		Analisis : A. Doni R.

Picture 13. Captured at: fin pendingin sisi selatan – timur (bagian dalam)


Date & Time: 29/09/2017 8:10:26

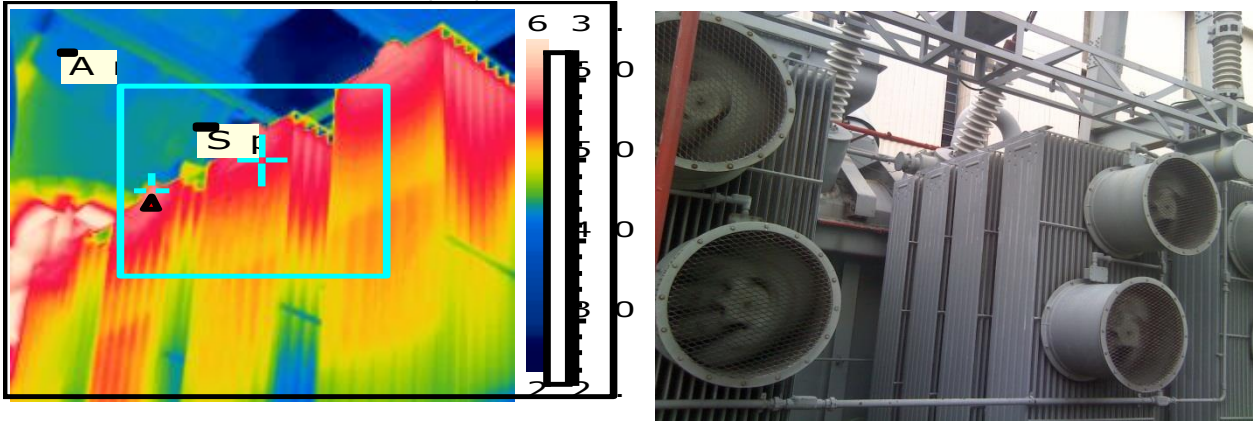


Max Temperature	65.8 °C
Ar1 Max. Temperature	57.9 °C
Sp1 Temperature	55.2 °C

Picture 14. Captured at: fin pendingin sisi selatan – barat (bagian dalam)

Date & Time: 29/09/2017 8:12:01

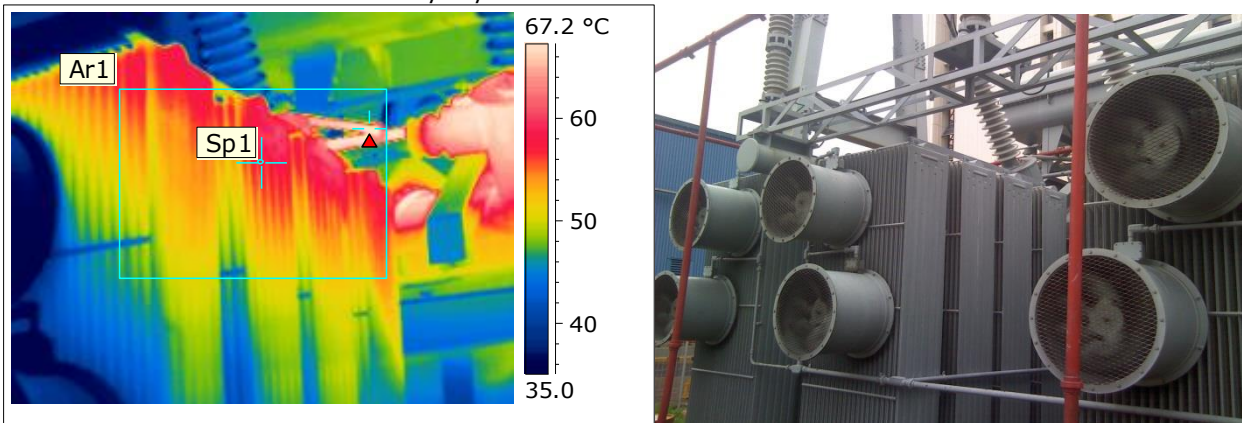


Max Temperature	68.9 °C
Ar1 Max. Temperature	68.3 °C
Sp1 Temperature	57.5 °C

	LAPORAN TECHNOLOGY OWNER	No. Dok. : _____
		Tanggal : 29/09/2017
		Technology : Thermograph
PT PJB UP MUARA KARANG	GENERATOR TRANSFORMER PLTU 5	Analisis : A. Doni R.

Picture 15. Captured at: Konsevator

Date & Time: 29/09/2017 8:12:29

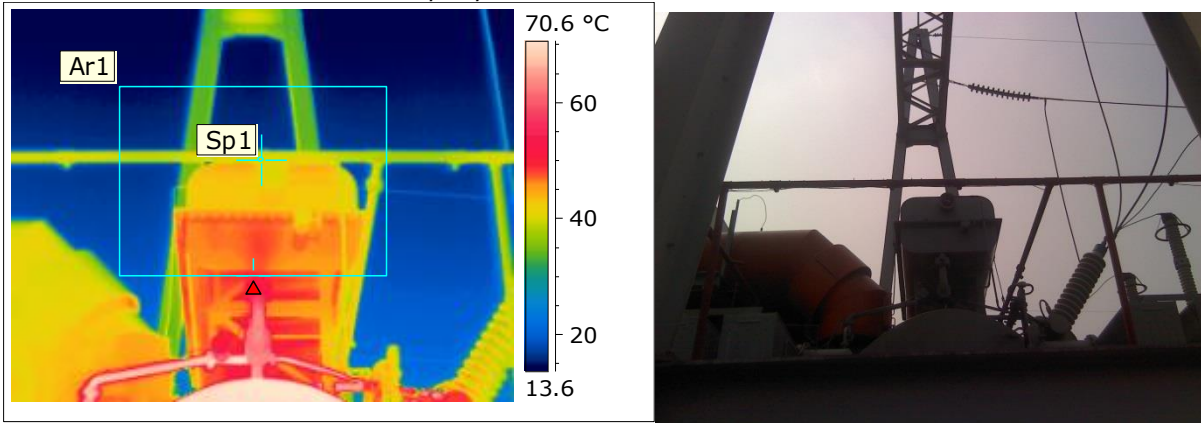

Max Temperature	71.1 °C
Ar1 Max. Temperature	51.1 °C
Sp1 Temperature	40.4 °C