LAMPIRAN

MiCOM
P122
AREVA
PT PLN (PERSERO)
TRANSMISI JAWA BAGIAN TENGAH
AKTIVA TETAP
TAHUN
2016
2017
2018
2019
TANGGAL & PARAF

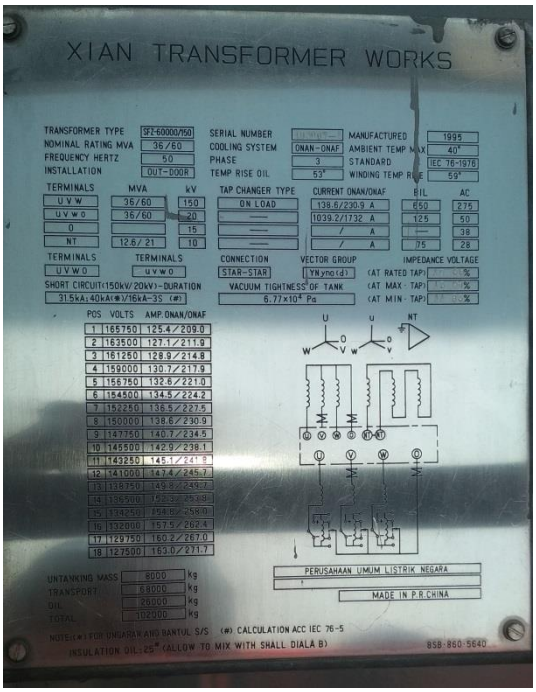
XIAN TRANSFORMER WORKS
TRANSFORMER TYPE
SERIAL NUMBER
MANUFACTURED
NOMINAL RATING MVA
COOLING SYSTEM
AMBIENT TEMP MAX
FREQUENCY HERTZ
PHASE
STANDARD
INSTALLATION
TEMP RISE OIL
WINDING TEMP RISE
TERMINALS
MVA
kV
TAP CHANGER TYPE
CURRENT ONAN/ONAF
BIL
AC
CONNECTION
VECTOR GROUP
IMPEDANCE VOLTAGE
SHORT CIRCUIT
VACUUM TIGHTNESS OF TANK
POS VOLTS AMP. ONAN/ONAF
PERUSAHAAN UMUM LISTRIK NEGARA
MADE IN P.R.CHINA

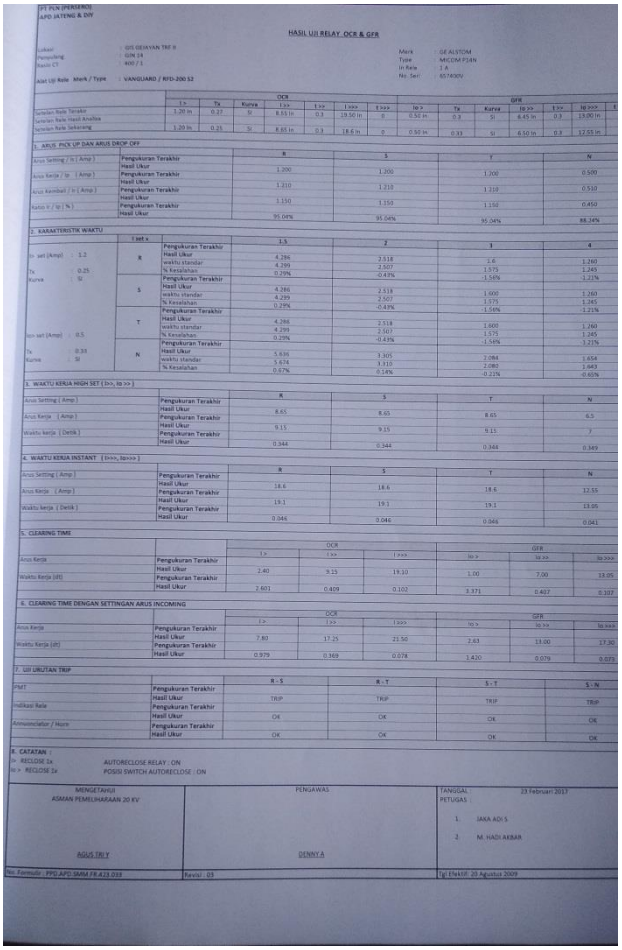
HASIL UJI RELAY OCR & GFR
1. ARUS PICK UP DAN ARUS DROP OFF
2. KARAKTERISTIK WAKTU
3. WAKTU KERJA HIGH SET
4. WAKTU KERJA INSTANT
5. CLEARING TIME
6. CLEARING TIME DENGAN SETTINGAN ARUS INCOMING
7. URUTAN TRIP
8. CATATAN
MENGETAHUI
PENGAWAS
DENNY A