

LAMPIRAN

PEMANTAUAN PEMAKAIAN LISTRIK

Bulan Agustus

Tgl.	waktu		Amax	Amax
	LWBP	WBP	LWBP	WBP
1	13.00 / 15.00	17.00 / 19.00	1015	987
2	13.00 / 15.00	17.00 / 19.00	1014	987
3	13.00 / 15.00	17.00 / 19.00	1021	988
4	13.00 / 15.00	17.00 / 19.00	1027	972
5	13.00 / 15.00	17.00 / 19.00	1025	997
6	13.00 / 15.00	17.00 / 19.00	1035	1011
7	13.00 / 15.00	17.00 / 19.00	1034	996
8	13.00 / 15.00	17.00 / 19.00	1045	1013
9	13.00 / 15.00	17.00 / 19.00	1014	987
10	13.00 / 15.00	17.00 / 19.00	1016	978
11	13.00 / 15.00	17.00 / 19.00	1016	988
12	13.00 / 15.00	17.00 / 19.00	1013	1017
13	13.00 / 15.00	17.00 / 19.00	1016	988
14	13.00 / 15.00	17.00 / 19.00	1033	1011
15	13.00 / 15.00	17.00 / 19.00	1027	992
16	13.00 / 15.00	17.00 / 19.00	1013	987
17	13.00 / 15.00	17.00 / 19.00	1014	989
18	13.00 / 15.00	17.00 / 19.00	1027	996
19	13.00 / 15.00	17.00 / 19.00	1019	987 987
20	13.00 / 15.00	17.00 / 19.00	1016	988 988
21	13.00 / 15.00	17.00 / 19.00	1019	996
22	13.00 / 15.00	17.00 / 19.00	1013	988 988
23	13.00 / 15.00	17.00 / 19.00	1019	988
24	13.00 / 15.00	17.00 / 19.00	1021	984
25	13.00 / 15.00	17.00 / 19.00	1011	988 988
26	13.00 / 15.00	17.00 / 19.00	1036	1014
27	13.00 / 15.00	17.00 / 19.00	1031	1016
28	13.00 / 15.00	17.00 / 19.00	1025	997
29	13.00 / 15.00	17.00 / 19.00	1014	988
30	13.00 / 15.00	17.00 / 19.00	1027	991
31	13.00 / 15.00	17.00 / 19.00	-	-


LAPORAN PENGOPERASIAN GENSET

Tanggal pemeriksaan : 24 April 2019

Penulisan	Item	Kode	Jam Operasi					
			10.00	10.30	10.30	11.00	11.00	
Voltage	Ampere	R	240 A	212 A	230 A	240 A	287 A	277 A
		S	212 A	192 A	237 A	235 A	244 A	255 A
		T	242 A	130 A	245 A	228 A	245 A	450 A
		R-S	200 V	380 V	480 V	380 V	380 V	480 V
		R-T	380 V	480 V	380 V	380 V	380 V	480 V
		S-T	380 V	380 V	380 V	380 V	380 V	380 V
		R-N	220 V	220 V	220 V	220 V	220 V	220 V
		S-N	220 V	220 V	220 V	220 V	220 V	220 V
		T-N	220 V	220 V	220 V	220 V	220 V	220 V
		Kw			119 kw	111 kw	134 kw	146 kw
Frekwensi			50 Hz	50 Hz	50 Hz	50 Hz	50 Hz	50 Hz

Catatan :

Diagram Single Line Kelistrikan gedung Ramai Mall Yogyakarta

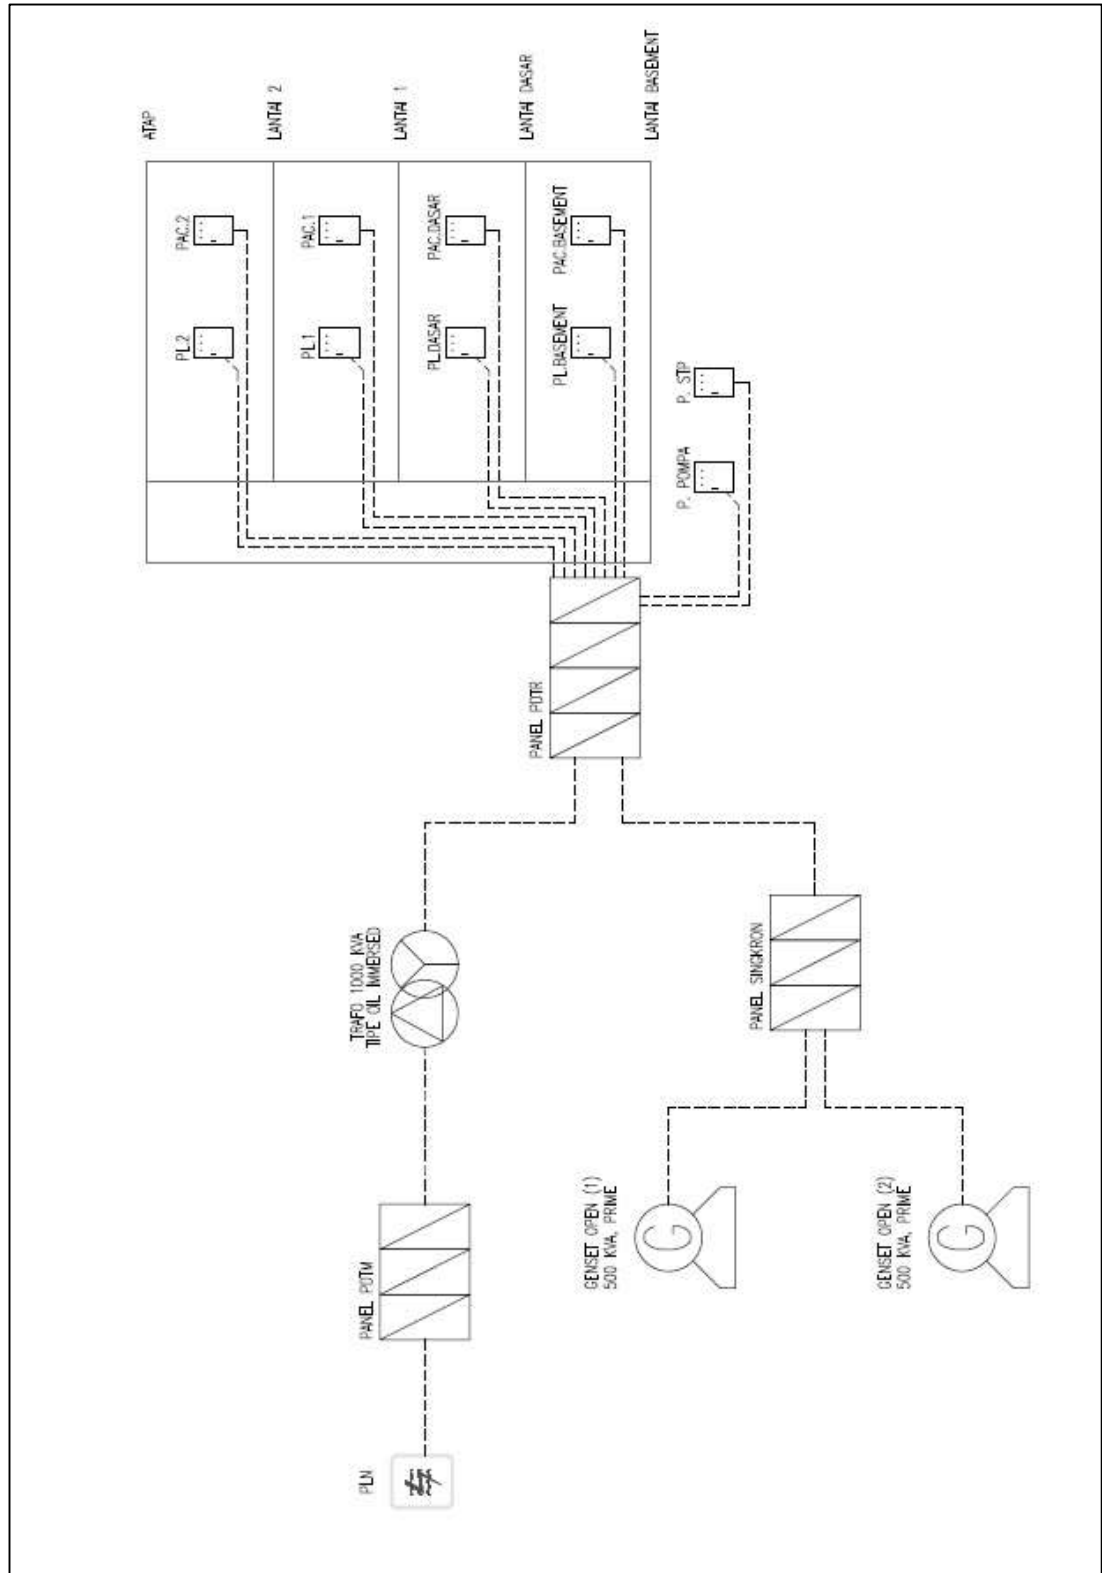

Trafomator Gedung Ramai Mall Yogyakarta



Panel Distribusi di Gedung Ramai Mall Yogyakarta

