



2. nempate trafo PT 14A-PTR-01B




### 3. Setting Relay Overcyrrent di PT. Pertamina RU VI Balongan

Relay di sisi 20 kv					
Relay	Arus (A)	Ratio CT (A)	Karakteristik invers		
			I set	TMS	T (s)
OCR	6A	400/5	1,2	0,4	0,05-2,4

Relay di sisi 3 kv					
Relay	Arus (A)	Ratio CT (A)	Karakteristik invers		
			I set	TMS	T (s)
OCR	5 A	3000/5	0,8	0,3	0,05-2,4

### 4. simulasi koordinasi relay, lock out relay dan PMT CB

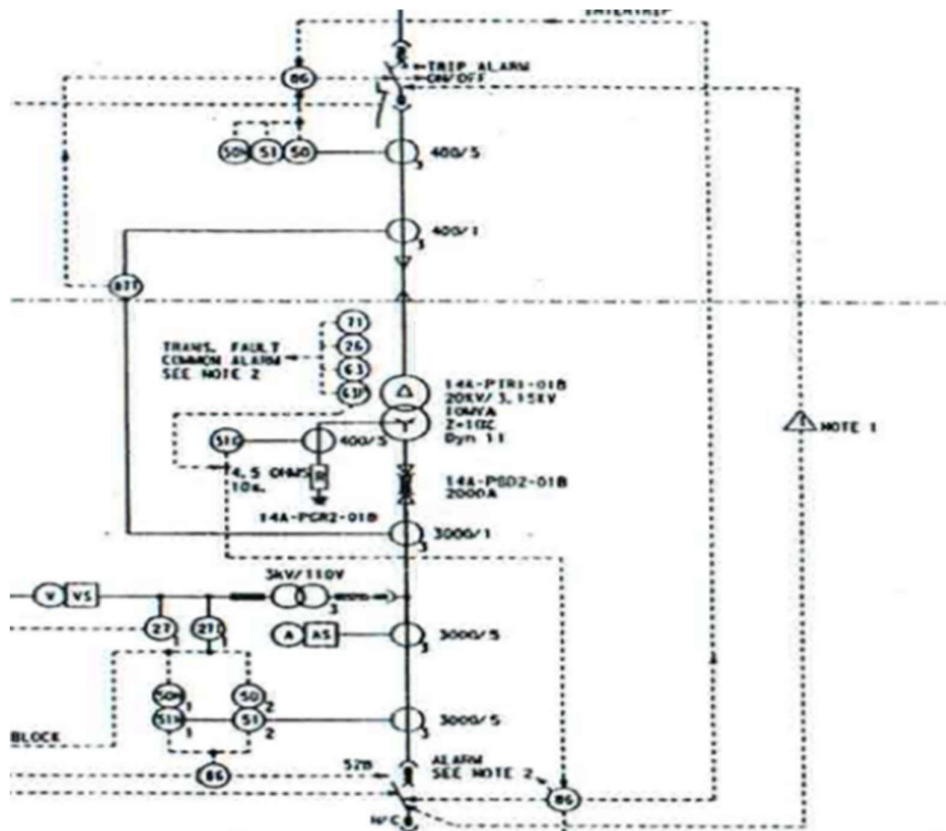

## 5. Bentuk fisik OCR ( Overcurrent Relay)

